

SUBMITTAL DATA - INDOOR UNIT VEHD024N432U VRF HIGH STATIC FAN COIL EVAPORATOR

Job Name:	Engineer:
Location:	Architect:
Schedule No.:	Date:
System Designation:	For: Reference Approval Review Construction

FEATURES

- Auto Addressing installation
- Auto Restart
- · Adjustable ESP Setting
- Integrated Condensate Pump
- Built-in Electronic Expansion Valve
- LED Display

- Flare Connections
- Anti-Freezing Protection
- Steel Cabinet

PRODUCT WARRANTY

All covered components - one year limited warranty


SPECIFICATIONS PERFORMANCE

Cooling Capacity* (Btu/h)		24,225
Heating Capacity* (Btu/h)		27,296
Airflow (CFM)	High	650
	Medium	530
	Low	410
External Static Pressure	Pa	0 - 100
	in. WC	0 - 0.4
Sound Pressure Level (dBA)	H/M/L	45/41/37



ELECTRICAL DATA		
Power Supply (V / Hz / Ph)	220-240/50/1 - 2	208-230/60/
MOP (A)		6
Rated Current (A)	Cooling	0.6
	Heating	0.6
DIMENSIONS		
Unit Dimensions (in)	Height	10 1/2
	Width	50
	Depth	22
Liquid Pipe Connection (in)		3/8
Gas Pipe Connection (in)		5/8
Shipping Weight (lb)		88.2



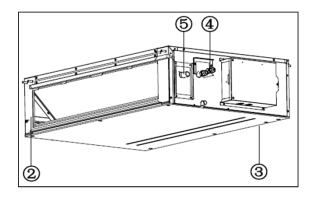

- 1. Air Filter
- 2. Air Inlet
- 3. Air Outlet
- 4. Fittings
- 5. Drain Pipe

NOTES:

Net Weight (lb)

*Cooling and Heating Capacity data is rated at the following

Cooling: 80 °F DB / 67 °F WB Indoor, 95 °F DB Outdoor

Heating: 70 °F DB Indoor, 47 °F DB


NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. ©2014 Lennox Industries Inc.

77.2



SUBMITTAL DATA - INDOOR UNIT VEHD024N432U VRF HIGH STATIC FAN COIL EVAPORATOR

DIMENSIONAL DRAWINGS

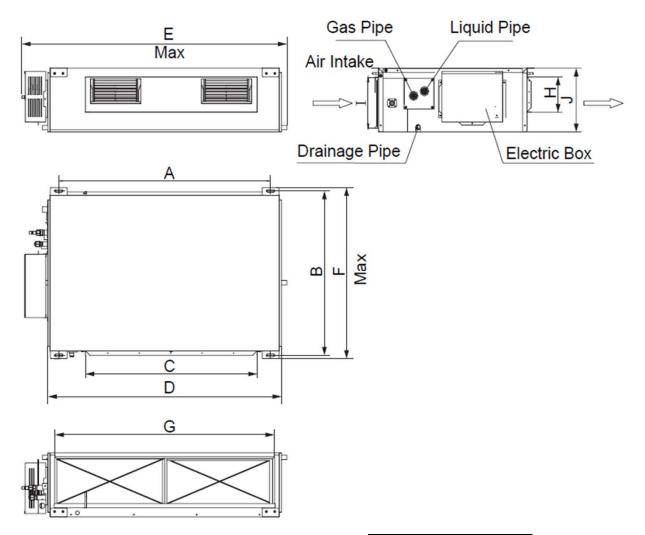

	mm	in
Α	1101	43.34
В	517	20.35
C	820	32.28
D	1159	45.63
Е	1271	50
F	558	22
G	1002	39.44
H	160	6.3
	235	9.25
J	268	10.5

NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. ©2014 Lennox Industries Inc.